



Inhibition of bacterial growth of IPS Kalyxx Blue Line 1/2"

Report date November 11th, 2019


Test date November 5th, 2019

Time	Water mixed Bacteria	Water mixed Bacteria with IPS Kalyxx Blue Line 1/2"	% Efficiency
0 hour	214,000	225,000	
24 hours	910,000	560,000	38.46

Method : AOAC official methods sm (991.14 coliform and Escherichia coli count in food, dry rehydratable film)

incubate petrifilm AC plates 48 + 3 h at 35^oC + 1^oC

Picture

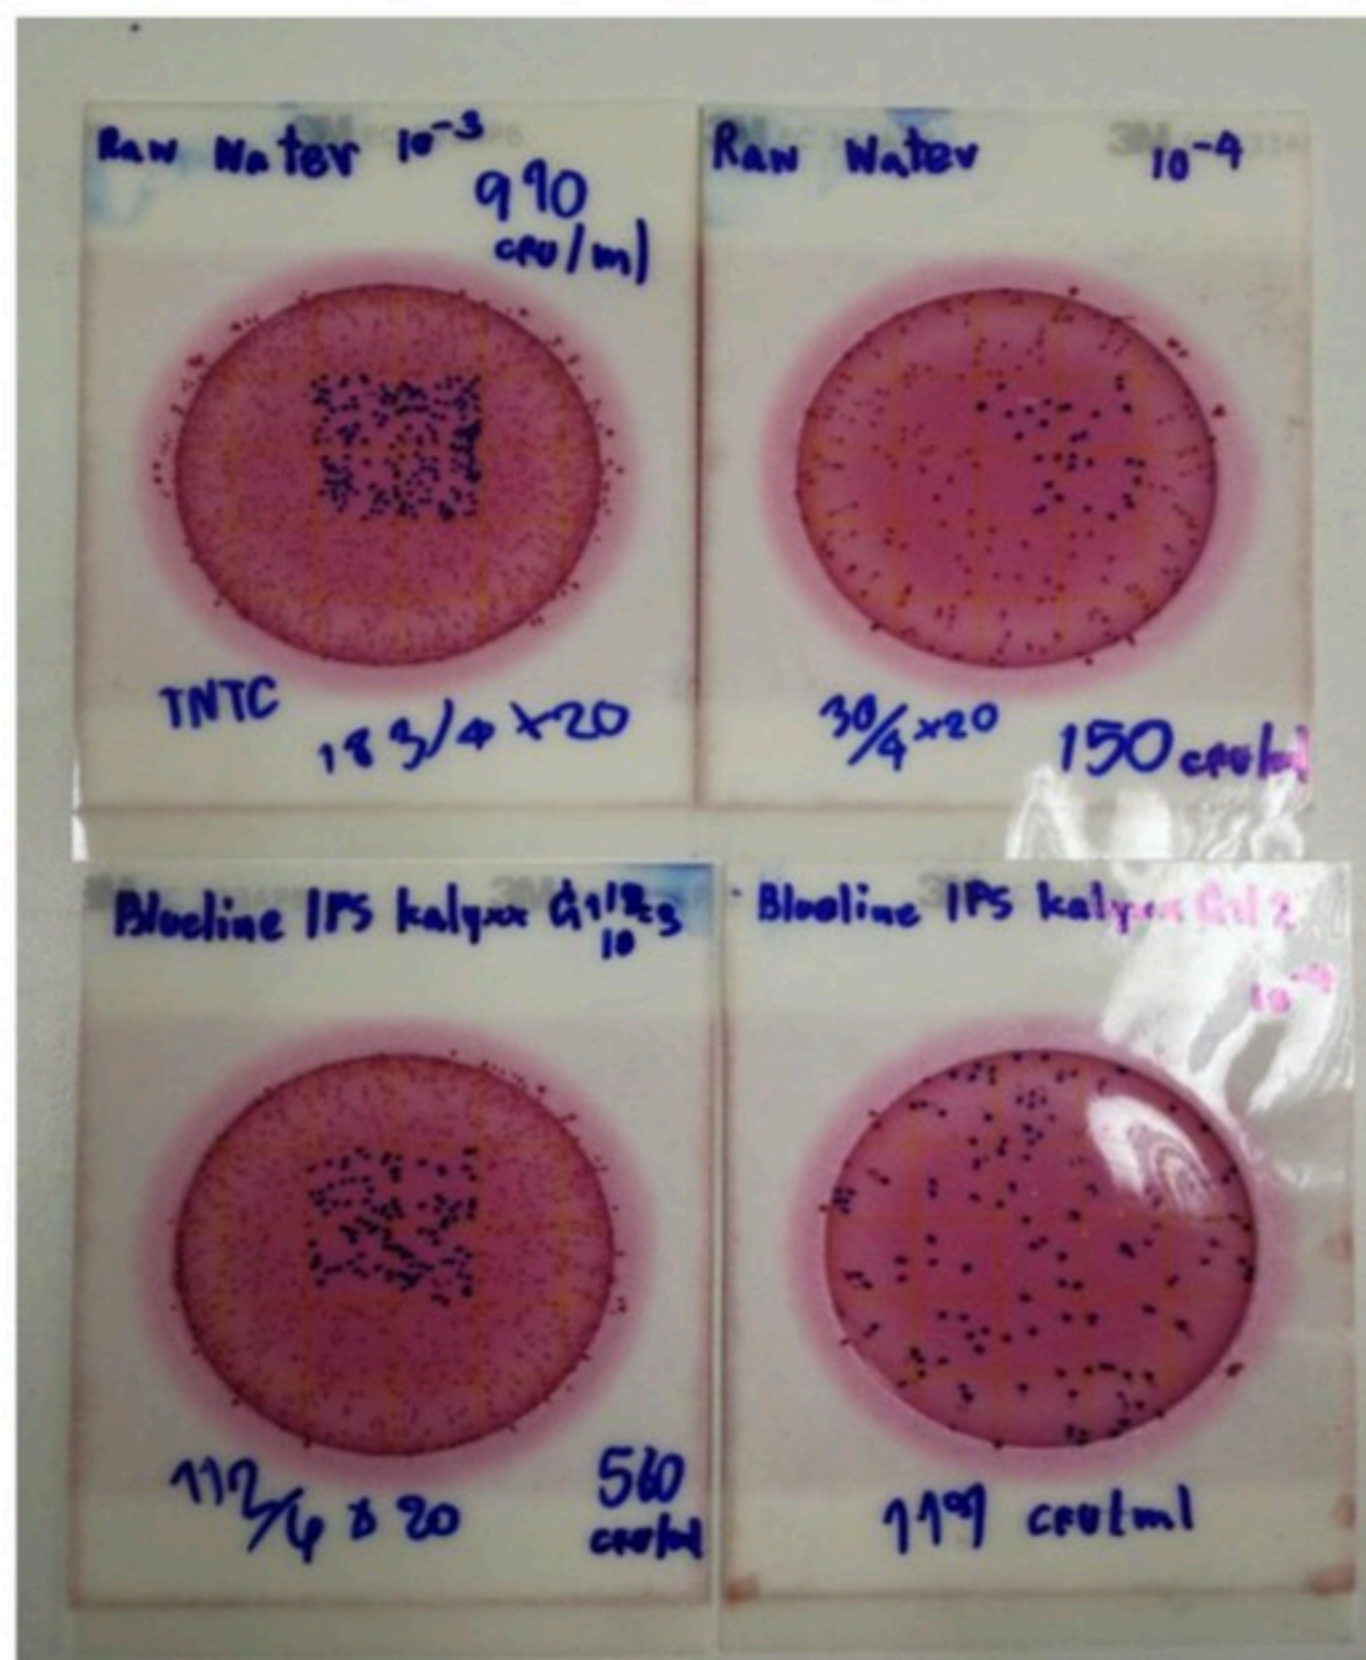

Analyst

Ms. Tidarat Boonsri